



Servicenter



1M000000

Catalog Number

Type QL-WP


9T17S0002

22.5 KVA 60 HZ 3 PH 3.8 % IMP


40 C AMB. 150 C RISE 220 C SYSTEM IS-19C

Note: Design is based on 30.00KVA & 150C Rise 5% Imp.

PRIMARY (H) 240 VOLTS (LINE-LINE)
 SECONDARY (X) 208 VOLTS (LINE-LINE)
 120 VOLTS (LINE-NEUTRAL)

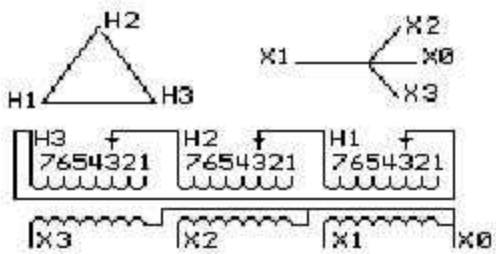

COIL TAP ARRANGEMENT

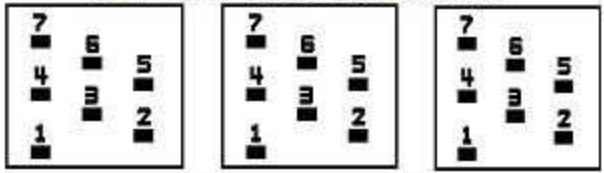

JUMPER CONNECTION	
TAP	VOLTS
1	252
2	246
3	240
4	234
5	228
6	222
7	216

NET WGT
 330 LB
 149.7 Kg
 53616
 UX72A
 NOG
 063016

INSPECTION & FINAL TEST N627!



LISTED 769G

Assembled in Mexico

ENCLOSURE TYPE 2 (IP20). OR RAINPRO-OF TYPE 3R (IP22) WHEN PROVIDED SHIELD

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP008
 ALUMINUM CONDUCTOR PRIMARY: 10 KV BIL SECONDARY: 10 KV BIL

Outline: 303B-424SSP022


IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE

X3 H3 X2 H2 X1 H1 X0

Note: standard

X0
H1
H1
H2
H2
H3
H3

X0
H1
H1
H2
H2
H3
H3

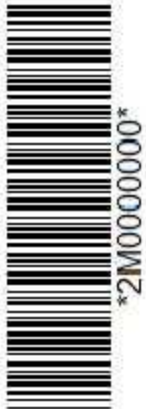

2M000000



3M000000