



Servicenter



1M000000

Catalog Number

9T17S0003


Type QL-WP

30.0 KVA 60 HZ 3 PH 5 % IMP


40 C AMB. 150 C RISE 220 C SYSTEM IS-19C

Note: Design is based on 30.00KVA & 150C Rise 5% Imp.

PRIMARY (H) 240 VOLTS (LINE-LINE)
SECONDARY (X) 208 VOLTS (LINE-LINE)
120 VOLTS (LINE-NEUTRAL)

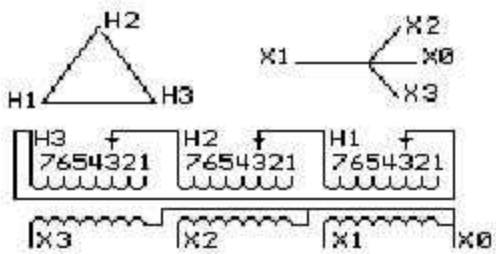

COIL TAP ARRANGEMENT

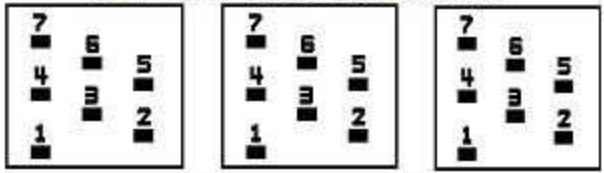

JUMPER CONNECTION	
TAP	VOLTS
1	252
2	246
3	240
4	234
5	228
6	222
7	216

NET WGT
330 LB
149.7 Kg

53616
UX72A
NOG
063016

INSPECTION & FINAL TEST N627!



LISTED 769G

Assembled in Mexico

ENCLOSURE TYPE 2 (IP20). OR RAINPRO-OF TYPE 3R (IP22) WHEN PROVIDED SHIELD

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP008
ALUMINUM CONDUCTOR PRIMARY: 10 KV BIL SECONDARY: 10 KV BIL


Outline: 303B-424SSP030

IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE

X3 H3 X2 H2 X1 H1 X0


Note: standard

X0
X1 H1
X2 H2
X3 H3

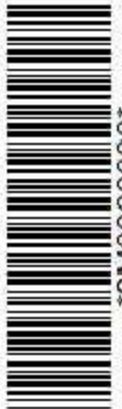

2M000000

X0
X1 H1
X2 H2
X3 H3

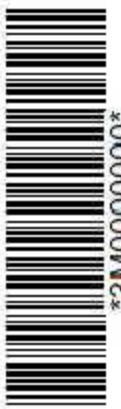

3M000000