


CERTIFICATE OF SEISMIC COMPLIANCE

For PowerVac Medium Voltage Distribution Breakers

Qualified to IEEE-693-2005

Qualified to IBC-2006

$S_{ds} = 1.3g, S_s = 200\%, I_p = 1.5$, for $z/h > 0$
 $S_{ds} = 2.0g, S_s = 300\%, I_p = 1.5$, for $z/h = 0$
in accordance with ICC-ES-AC156.

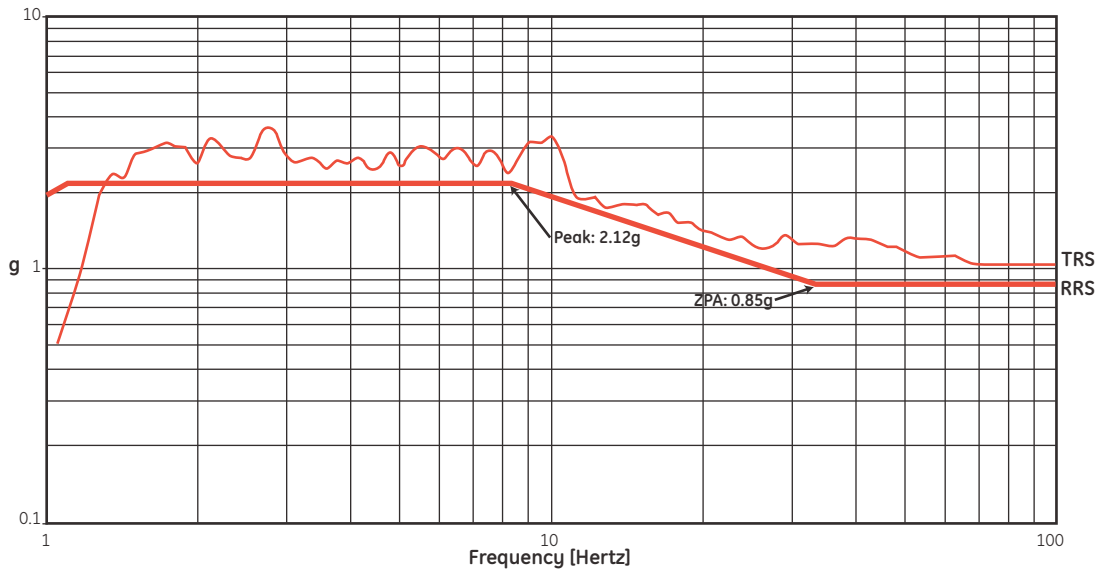

Lowest equipment natural frequency: 3.9 Hz

Qualified by shake-table testing,

Clark Dynamic Test Laboratory, Jan. 2006, Mar. 2006

THIS IS TO CERTIFY THAT THE ABOVE NAMED EQUIPMENT MEETS OR EXCEEDS ALL OF THE ABOVE REQUIREMENTS ACCORDING TO IEEE-693-2005 AND IBC-2006.

Certification Report Prepared by

W. E. Gundy & Associates, Inc.
P.O.Box 2900, Hailey, ID, 83333

See GE document 10095951P1 for Certification Report, interpretation of test data and P.E. stamp.

