


CERTIFICATE OF SEISMIC COMPLIANCE

For QL and TransforMore Series Transformers

Qualified to IEEE-693-2005
Qualified to IBC-2006

Wall mounted
 $S_{ds} = 1.0g, S_s = 150\%, I_p = 1.5$, for $z/h > 0$
 $S_{ds} = 1.6g, S_s = 240\%, I_p = 1.5$, for $z/h = 0$
in accordance with ICC-ES-AC156.

Floor mounted
 $S_{ds} = 1.3g, S_s = 200\%, I_p = 1.5$, for $z/h > 0$
 $S_{ds} = 2.0g, S_s = 300\%, I_p = 1.5$, for $z/h = 0$

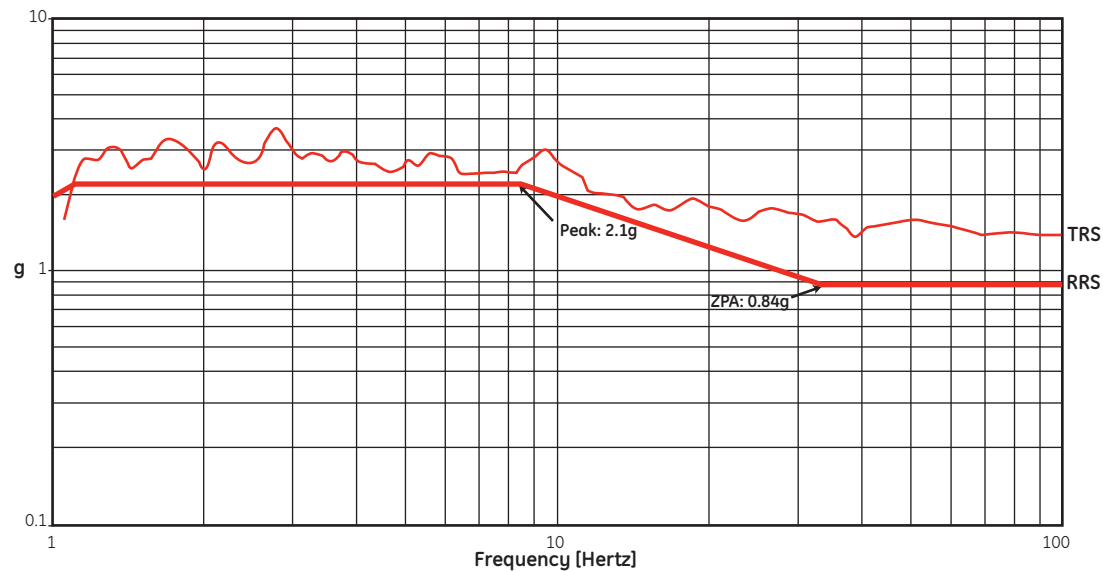

Graph shown is for floor mounted transformers Qualified by shake-table testing,
Lowest equipment natural frequency: 3.9 Hz Clark Dynamic Test Laboratory, Jan. 2006, Feb. 2006, Apr. 2006, Apr. 2008

THIS IS TO CERTIFY THAT THE ABOVE NAMED EQUIPMENT MEETS OR EXCEEDS ALL OF THE ABOVE REQUIREMENTS ACCORDING TO IEEE-693-2005 AND IBC-2006.

Certification Report Prepared by

W. E. Gundy & Associates, Inc.
P.O.Box 2900, Hailey, ID, 83333

See GE document 10095845P2 for Certification Report, interpretation of test data and P.E. stamp.

