



# Transformer



\*1M000000\*

Catalog Number  
**9T10C1004G62**


Type **QL**

**75.0 KVA 60 HZ 3 PH 3.2 % IMP**


40 C AMB. 80 C RISE 220 C SYSTEM IS-19C

Note: Design is based on 112.5KVA & 150C Rise 5% Imp.

PRIMARY (H) 480 VOLTS (LINE-LINE)  
SECONDARY (X) 208 VOLTS (LINE-LINE)  
120 VOLTS (LINE-NEUTRAL)

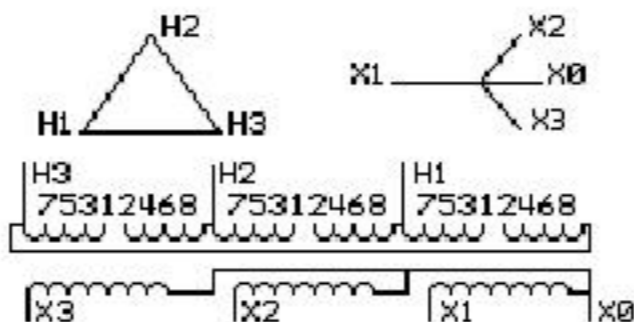

### COIL TAP ARRANGEMENT

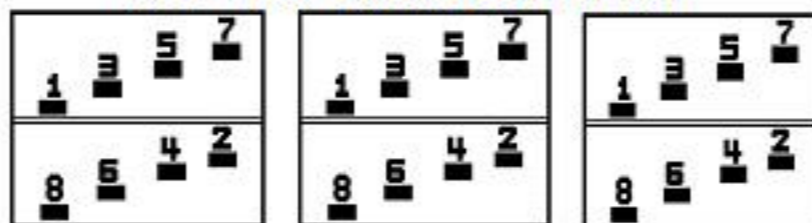

| JUMPER CONNECTION |       |
|-------------------|-------|
| TAP               | VOLTS |
| 1-2               | 503   |
| 2-3               | 492   |
| 3-4               | 480   |
| 4-5               | 469   |
| 5-6               | 457   |
| 6-7               | 446   |
| 7-8               | 435   |

NET WGT  
790 LB  
358.3 Kg

60472  
DY75C

NOG  
032916

INSPECTION  
&  
FINAL TEST  
N614!



LISTED 769G

Assembled in Mexico

ENCLOSURE TYPE 2 (IP20). OR RAINPROOF TYPE 3R (IP22) WHEN PROVIDED SHIELD 9T18Y1074G06

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001  
COPPER CONDUCTOR PRIMARY: 10 KV BIL SECONDARY: 10 KV BIL

Outline:  
303B111GEDYP75C

**IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES  
CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE**

X3 - X2 - X1 - -  
- H3 - H2 - H1

Note: X0 at the bottom

X1 - -  
X2 - H1  
X3 - H2 - H1  
X1 - X0  
X2 - H2  
X3 - H3 - H1  
X2 - H2  
X3 - H3 - H1



\*2M000000\*



\*3M000000\*