



# Transformer



\*1M000000\*


Catalog Number  
**9T11C1005G64**

Type **QL**

**112.5 KVA 60 HZ 3 PH 4.4 % IMP**

40 C AMB. 80 C RISE 220 C SYSTEM IS-19C

Note: Design is based on 150.0KVA & 115C Rise 5.3% Imp.

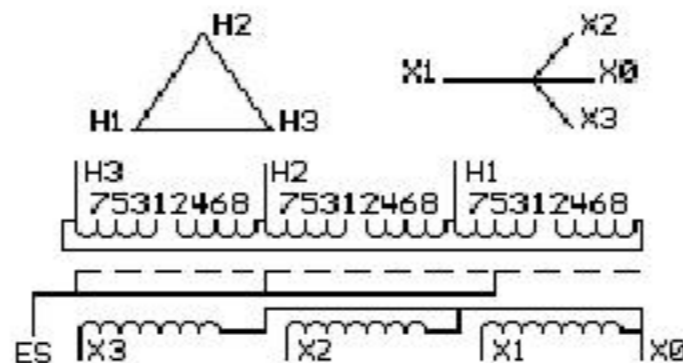

JUMPER CONNECTION	
TAP	VOLTS
1-2	506
2-3	493
3-4	480
4-5	468
5-6	455
6-7	442
7-8	430

NET WGT  
1240 LB  
562.5 Kg


60418  
DK76C

NOG  
032916

INSPECTION  
&  
FINAL TEST  
N614!

PRIMARY (H) 480 VOLTS (LINE-LINE)  
 SECONDARY (X) 208 VOLTS (LINE-LINE)  
 120 VOLTS (LINE-NEUTRAL)

### COIL TAP ARRANGEMENT

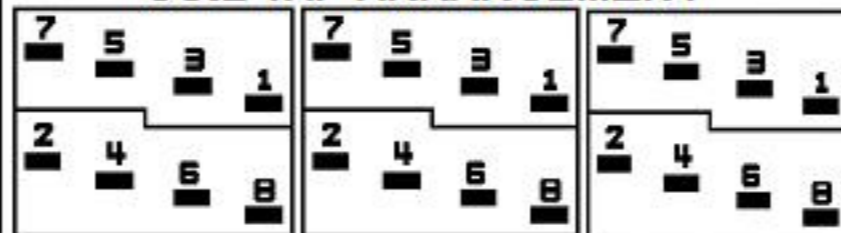

LISTED 769G

ELECTROSTATIC GROUND SHIELD IN EACH PHASE

ENCLOSURE TYPE 2 (IP20). OR RAINPROOF TYPE 3R (IP22) WHEN PROVIDED SHIELD 9T18Y1076G06

SUITABLE FOR NONSINUSOIDAL CURRENT LOAD WITH K-FACTOR NOT TO EXCEED 13

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001

COPPER CONDUCTOR

PRIMARY: 10 KV BIL

SECONDARY: 10 KV BIL

Outline:

303B111GEDXP76C


Assembled in Mexico

X3 - X2 - X1 - -  
 - H3 - H2 - H1


Note: X0 at the bottom

IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES  
 CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE

X1 - -  
 X2 - H1  
 H3 - H2  
 X3 - X1 - H1  
 X2 - H2  
 H3 - H2  
 X3 - X2 - H1  
 H3 - H2  
 X3 - H3 - H1  
 X0

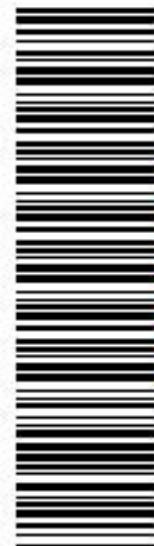

\*2M000000\*

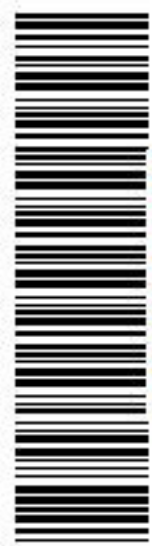

\*3M000000\*