



Transformer



1M000000

Catalog Number


Type QL

9T83B4007G05


75.0 KVA 60 HZ 3 PH 7.2 % IMP

40 C AMB. 150 C RISE 220 C SYSTEM IS-19C

PRIMARY (H) 600 VOLTS (LINE-LINE)
SECONDARY (X) 230 VOLTS (LINE-LINE)

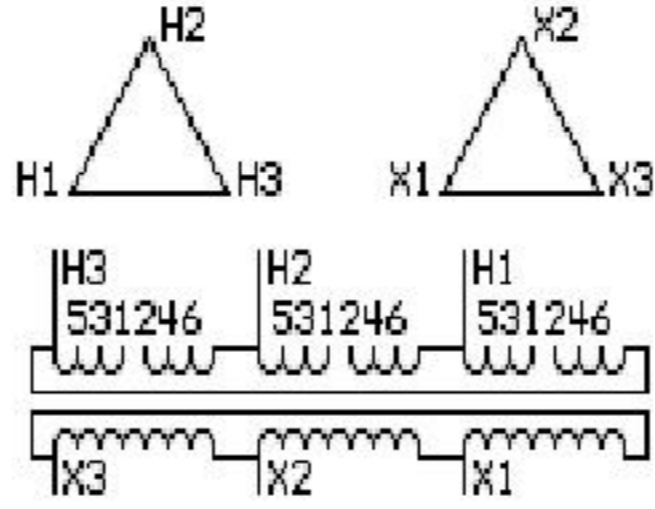

COIL TAP ARRANGEMENT

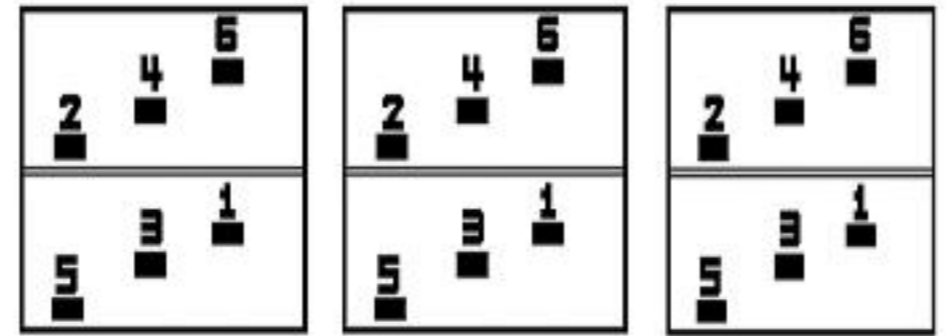

JUMPER CONNECTION

TAP	VOLTS
1-2	529
3-4	500
5-6	571

NET WGT
620 LB
281.2 Kg

55720
XU374
NOG
072915

INSPECTION
&
FINAL TEST
N531!



LISTED 769G

Assembled in Mexico

ENCLOSURE TYPE 2 (IP30). RAINPROOF TYPE 3R ENCLOSURE (IP32) WHEN PROVIDED SHIELD 9T18Y4317G06


BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001 Outline: 303B401AAP074
ALUMINUM CONDUCTOR PRIMARY: 10 KV BIL SECONDARY: 10 KV BIL

IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODES.


X3 - X2 - X1 - -
- H3 - H2 - H1

Note: Standard

X1 - - H1
X2 - - H2
X3 - - H3

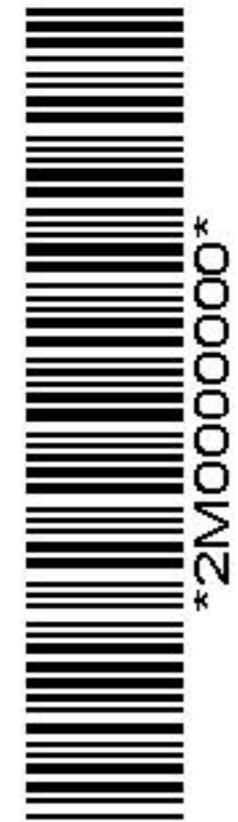

2M000000

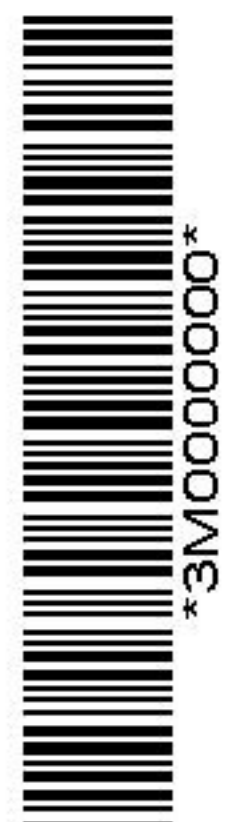

3M000000