




# Transformer

Catalog Number

**9T83C9539**

**500.0 KVA    60 HZ    3 PH    3.4 % IMP**

40 C AMB.    150 C RISE    220 C SYSTEM    IS-19C    Type: QL

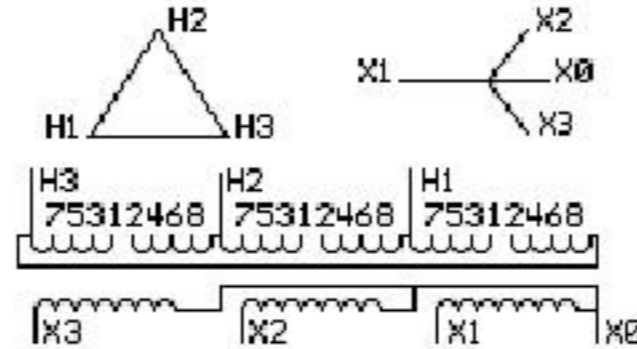


### JUMPER CONNECTION

TAP	VOLTS
1-2	498
2-3	487
3-4	480
4-5	467
5-6	455
6-7	445
7-8	434

PRIMARY (H)    480 VOLTS (LINE-LINE)  
 SECONDARY (X)    380 VOLTS (LINE-LINE)  
                           219 VOLTS (LINE-NEUTRAL)

### COIL TAP ARRANGEMENT

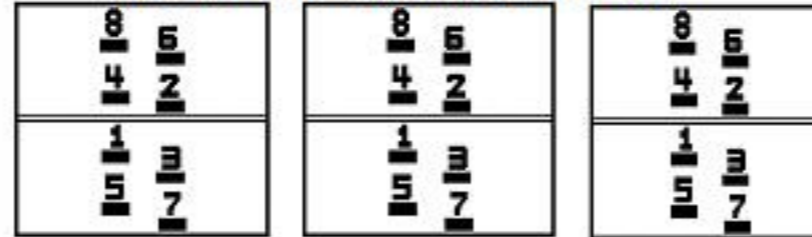

NET WGT 4050 LB    1837.1 Kg

090115    N536!    YF379  
                  55804    NOG

ENCLOSURE TYPE 2 (IP30). RAINPROOF TYPE 3R ENCLOSURE (IP32) WHEN PROVIDED SHIELD 9T18Y4322G 68

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001  
COPPER CONDUCTOR    PRIMARY: 10 KV BIL    SECONDARY: 10 KV BIL

**IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODES.**



LISTED 769G

Outline: 3038919AAP179  
Assembled in Mexico

INSPECTION & FINAL TEST  
N536!

