



# Transformer



\*M0000000\*


Catalog Number      Type QL

9T83C9803


45.0 KVA    60 HZ    3 PH 5.3 % IMP

40 C AMB.    150 C RISE    220 C SYSTEM    IS-19C

PRIMARY (X)    208 VOLTS (LINE-LINE)  
SECONDARY (H)    480 VOLTS (LINE-LINE)  
                          277 VOLTS (LINE-NEUTRAL)

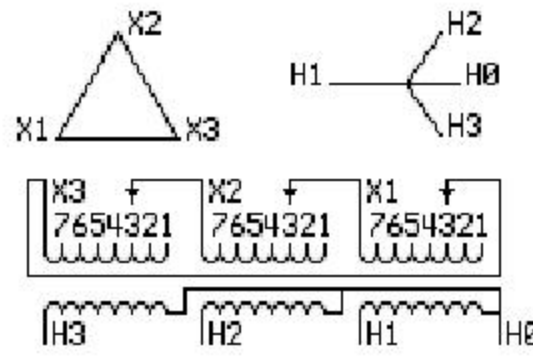

### COIL TAP ARRANGEMENT

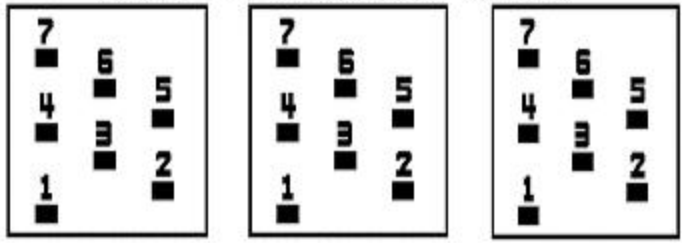

JUMPER CONNECTION	
TAP	VOLTS
1	219
2	214
3	208
4	202
5	197
6	194
7	188

NET WGT  
490 LB  
222.3 Kg  
9T83C9803  
22430  
WU373  
NOG  
020413

INSPECTION  
&  
FINAL TEST  
N306!



ENCLOSURE TYPE 2 (IP30). RAINPROOF TYPE 3R ENCLOSURE (IP32) WHEN PROVIDED SHIELD 9T18Y4317G05

Assembled in Mexico


BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001      Outline: 303B401AAP073  
COPPER CONDUCTOR      PRIMARY: 10 KV BIL      SECONDARY: 10 KV BIL

IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES  
CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODES.


H3 - H2 - H1 - -  
- X3 - X2 - X1

Note: H0 Terminal at the bottom

H3 - H2 - H1 - -  
- X3 - X2 - X1  
H3 - H2 - H1 - -  
- X3 - X2 - X1  
H0

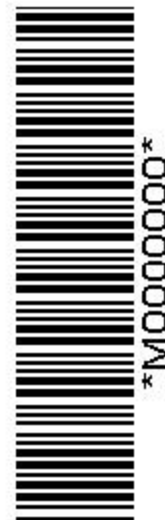

\*M0000000\*

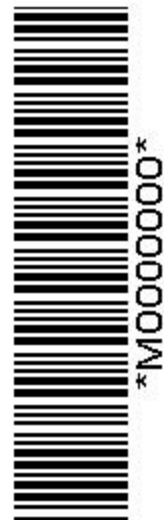

\*M0000000\*