




# Transformer

Catalog Number

**9T83C9899**

**500.0 KVA    60 HZ    3 PH    4.7 % IMP**

40 C AMB.    150 C RISE    220 C SYSTEM    IS-19C    Type: QL

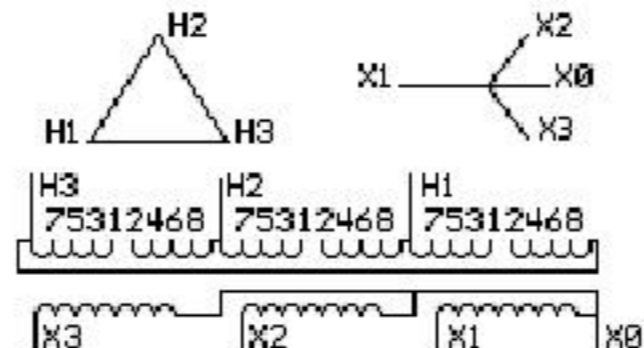


### JUMPER CONNECTION

TAP	VOLTS
1-2	630
2-3	610
3-4	600
4-5	580
5-6	570
6-7	550
7-8	540

PRIMARY (H)    600 VOLTS (LINE-LINE)  
 SECONDARY (X)    208 VOLTS (LINE-LINE)  
                           120 VOLTS (LINE-NEUTRAL)

### COIL TAP ARRANGEMENT

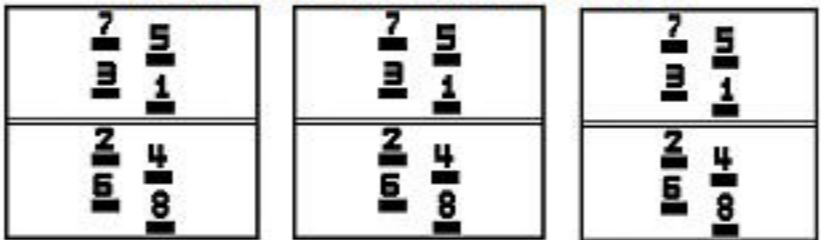

NET WGT 4050 LB    1837.1 Kg

090115    N536!  
55832    NOG

ENCLOSURE TYPE 2 (IP30). RAINPROOF TYPE 3R ENCLOSURE (IP32) WHEN PROVIDED SHIELD 9T18Y4322G 68

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001  
COPPER CONDUCTOR    PRIMARY: 10 KV BIL    SECONDARY: 10 KV BIL

**IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODES.**



LISTED 769G

Outline: 3038919AAP179    INSPECTION & FINAL TEST  
Assembled in Mexico    N536!

