



- NOTES:**
1. OPERATOR INTERFACE PANEL.
 2. MAIN INPUT CIRCUIT BREAKER.
 3. 225A SECONDARY MAIN CIRCUIT BREAKER.
 4. (42) POLE DISTRIBUTION PANELBOARDS.
 5. CT STRIP FOR BOMS (OPTIONAL).
 6. 1-4 (50-250A) SUBFEEDS.
 7. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
 8. MINIMUM OF 18" CLEARANCE FOR DOOR SWING.
 9. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
 10. BOMS CIRCUIT BOARD (OPTIONAL).

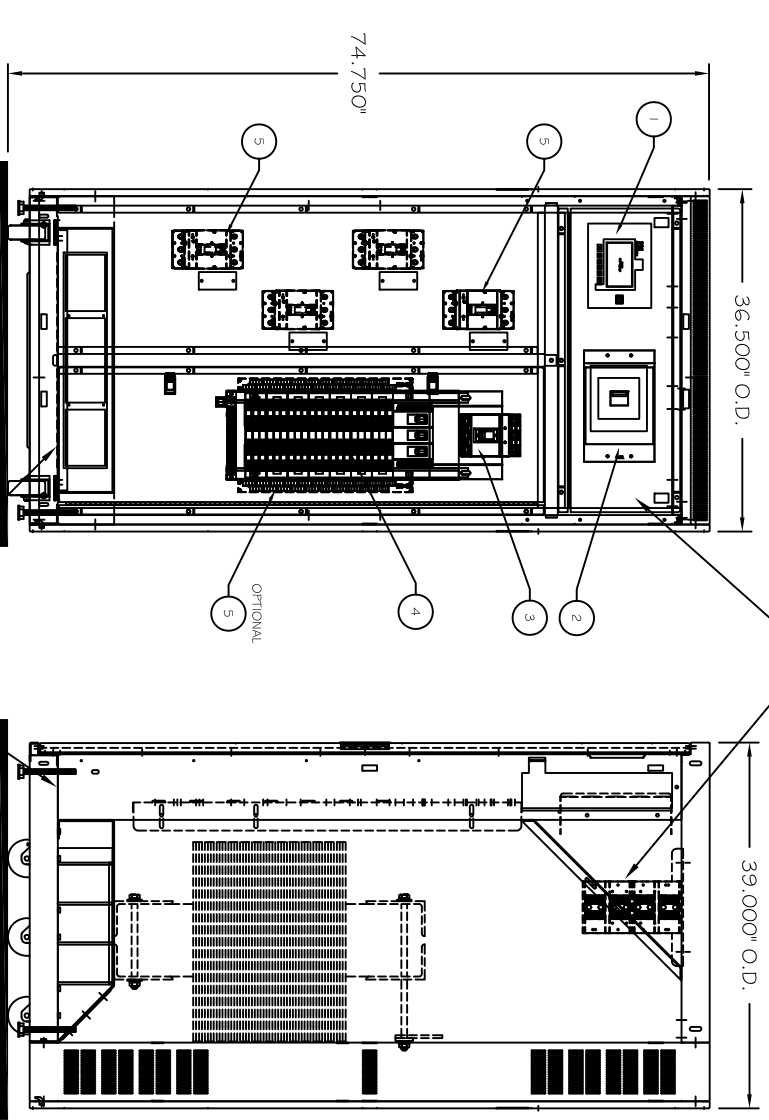

<p>THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED WRITTEN PERMISSION OF GENERAL ELECTRIC CO.</p>	
<p>TITLE GE ZENITH SERIES MDU, CLASSIC DESIGN 200-300kva</p>	
<p>(4) SUBFEED CBS & PANEL WITH BOMS OPTION</p>	
DWG. NUMBER	REVISION
DWG11008-GE	A2
DRAWN BY	CHECKED BY
RAE	KH
DATE	DATE
06-23-10	01-02-13
	
<p>GE Critical Power</p>	